







PACKAGED ROOF TOP UNIT SCHEDULE			
UNIT SYMBOL		 (EXISTING)	 (EXISTING)
LOCATION		ROOF	ROOF
BLOWER	CFM	4,600 (12.5-TON)	4,000 (10-TON)
	TSP (IN W.G.)	0.7"	0.7"
COOLING	TOTAL (BTU/HR)	155,800	113,350
	SENSIBLE (BTU/HR)	133,600	91,540
	AMBIENT (F)	100	100
	COIL ENTERING	66 WB/80 DB	66 WB/80 DB
HEATING (BTU/HR)		180,000 (INPUT) /148,000 (OUTPUT)	180,000 (INPUT) / 148,000 (OUTPUT)
ELECTRICAL	POWER SUPPLY	460V/3PH/60HZ	460V/3PH/60HZ
	COMPRESSOR (RLA)	(2) 8.2	(2) 7.7
	CONDENSER MOTOR (FLA)	(3) 0.8	(1) 3.1
	EVAPORATOR MOTOR (FLA)	5.3	5.3
MIN. CIRCUIT AMPACITY		27, HACR = 30	26, HACR = 30
PRICING ORDERING AND DELIVERY CONTACT: THERESA DAWSON PHONE: 949-309-9815 E-MAIL: Theresa.Dawson@carrier.utc.com			
BY CARRIER 48HCDD14 DOWN DISCHARGE COMPLETE WITH 14" ROOF MOUNT CURB, ELECTRONIC PROGRAMMABLE THERMOSTAT, ENTHALPHY ECONOMIZER WITH BAROMETRIC RELIEF. COMB. FAN MOTOR 0.48 AMPS (DOES NOT OPERATE WITH COMPRESSOR). OPER. WT. : 1504 LBS APPROX. SEER=N/A EER=11.5, AFUE=82%			
BY CARRIER 48HCDD12 DOWN DISCHARGE COMPLETE WITH 14" ROOF MOUNT CURB, ELECTRONIC PROGRAMMABLE THERMOSTAT, ENTHALPHY ECONOMIZER WITH BAROMETRIC RELIEF. COMB. FAN MOTOR 0.48 AMPS (DOES NOT OPERATE WITH COMPRESSOR). OPER. WT. : 1504 LBS APPROX. SEER=N/A EER=11.5, AFUE=82%			
ALL ITEMS RELATED TO HVAC SYSTEM SHALL BE PROVIDED AND INSTALLED BY CONTRACTOR. CONTACT CARRIER REPRESENTATIVE ABOVE. - THERMOSTATS: REMOTE SENSOR TYPE, 24/7 PROGRAMMABLE AND CAPABLE OF OPERATING ROOFTOP UNITS AND ACCESSORIES "CARRIER" COMFORT PRO 33CS PROVIDE REMOTE SENSOR FOR EACH THERMOSTAT - DUCT MOUNTED SMOKE DETECTORS: IONIZATION TYPE/UL LISTED, CSFM CERTIFIED, 24 VAC, BY EDWARDS, DH HOUSING WITH 1551F SENSOR. MECHANICAL CONTRACTOR SHALL ADDITIONALLY PROVIDE AND INSTALL ALL REMOTE RESETS, STROBES, AND ALARMS IF REQUIRED BY CODE & INSPECTOR - CONTRACTOR TO PROVIDE NEW 2" PLEATED FILTERS AT TURNOVER. NOTE: 1. 1.9 AMPS (5 TON) AND 3.8 AMPS (7.5 AND 10 TON) ECONOMIZER INCLUDED IN ELECTRICAL TOTAL MCA PER MANUFACTURER'S LITERATURE. 2. UNIT WEIGHTS ABOVE INCLUDE ACCESSORIES AND CURB. 3. FACTORY OPTIONS SHALL INCLUDE E-COAT INTERIOR COIL AL/CU -LOUVERED HAIL GUARD PROTECTION FOR ALL UNITS. 4. FACTORY OPTIONS SHALL INCLUDE FACTORY INSTALLED DISCONNECTS AND CONVENIENCE OUTLETS (FIELD POWERED REFER TO ELECTRICAL DRAWINGS) 5. PROVIDE THRU THE BASE ELECTRICAL CONNECTION KIT #CR8TMPVR002A01 FOR ALL UNITS.			

EXHAUST FAN SCHEDULE				
FAN NO.				
LOCATION		ROOF	ROOF	ROOF
AREA SERVED		KITCHEN GREASE EXHAUST HOOD #1	KITCHEN GREASE EXHAUST HOOD #2	RESTROOMS
FAN DUTY		AIR EXHAUST	AIR EXHAUST	AIR EXHAUST
FAN TYPE		CENTRIFUGAL BELT-DRIVEN	CENTRIFUGAL BELT-DRIVEN	CENTRIFUGAL BELT-DRIVEN
FAN ARRANGEMENT		UPBLAST	UPBLAST	DOWNBLAST
MIN. WHEEL DIAMETER		-	-	-
PERFORMANCE	C.F.M.	3,100	3,100	450
	T.S.P.	1.25"	1.25"	0.25"
	B.H.P.	1.229	1.229	0.085
	FAN R.P.M.	1171	1171	1128
MOTOR	MOTOR H.P.	2.0	2.0	0.25
	ELEC. CHARACTERISTICS	208V/3PH/60HZ	208V/3PH/60HZ	115V/1PH/60HZ
	MOTOR R.P.M.	1725	1725	-
	MOTOR SPECIAL FEATURES	OPEN DRIP-PROOF	OPEN DRIP-PROOF	OPEN DRIP-PROOF
ACCESSORIES		1. VENTED ROOF CURB 2. HINGED AND CHAINED FAN INSTALLATION FOR DUCT ACCESS	1. VENTED ROOF CURB 2. HINGED AND CHAINED FAN INSTALLATION FOR DUCT ACCESS	1. ROOF CURB 2. BACKDRAFT DAMPER
MANUFACTURER		CAPTIVEAIRE MODEL: EABDU18 WT. 184 LBS	CAPTIVEAIRE MODEL: EABDU18 WT. 184 LBS	CAPTIVEAIRE MODEL: EABDCR7 WT. 108 LBS

NOTES:

- KITCHEN EXHAUST FANS SHALL BE ELECTRICALLY INTERLOCKED WITH MAKE-UP AIR UNIT AND ROOFTOP UNITS.
- FOR WIRING DIAGRAM SEE 5/M-501


HVAC CONTROL SETTINGS	
EACH HVAC UNIT SHALL BE PROVIDED WITH CONTROLS AS FOLLOWS:	
THERMOSTAT: CARRIER COMMERCIAL PROGRAMMABLE THERMOSTAT WITH REMOTE TEMPERATURE SENSOR. SEE SHEET M-100 FOR THERMOSTAT AND SENSOR LOCATIONS.	
ALL THERMOSTATS SHALL HAVE MANUAL OVERRIDE.	
EACH UNIT CONTROL SHALL BE SET UP INITIALLY AS FOLLOWS:	
CONTRACTOR SHALL DETERMINE OCCUPIED PERIOD FROM OWNER.	
FAN OPERATION SHALL BE CONTINUOUS DURING OCCUPIED PERIOD AND CYCLE WITH COOLING/HEATING DURING UNOCCUPIED PERIOD.	
PROGRAMMED SETPOINTS (FOR EACH THERMOSTAT): COOLING OCCUPIED: 75°F. COOLING UNOCCUPIED: 85°F. HEATING OCCUPIED: 68°F. HEATING UNOCCUPIED: 50°F.	
NOTE: DEVIATIONS FROM THE ABOVE MAY RESULT IN UNACCEPTABLE AIR QUALITY, COMFORT AND/OR ENERGY CONSUMPTION.	

AIR CURTAIN SCHEDULE		
EQUIP.	MFR/MODEL	DESCRIPTION
	MARS STD242-1U-OB	UNHEATED AIR CURTAIN (SERVICE DOOR), 115/160 WEIGHT 65 LBS. PROVIDED BY PANDA EXPRESS
NOTES: INSTALL ACCORDING TO MANUFACTURER'S INSTRUCTIONS.		











MA-1 CONTROL SETTINGS	
EACH UNIT CONTROL SHALL BE SET UP INITIALLY AS FOLLOWS:	
FAN OPERATION SHALL BE CONTINUOUS DURING COOKING OPERATION INTERLOCK WITH KITCHEN EXHAUST FANS. REFER TO HOOD DRAWINGS.	
PROGRAMMED SETPOINTS : COOLING : 85°F. HEATING : 55°F.	

MAKE-UP AIR UNIT SCHEDULE										
MARK	MFR/ MODEL	LOCATION	SERVICE AREA	GAS HEAT	TYPE	COOLING	CFM	ESP	MOTOR	REMARKS
MA-1	CAPTIVEAIRE EA3-D.500-G18-MPU	ROOF-TOP	KITCHEN HOOD #1 & #2	INPUT: 308,938 BTU/HR OUTPUT: 284,223	DIRECT FIRE GAS HEATED, DX COOLED SUPPLY, DOWN DISCHARGE	DUAL CIRCUIT 5/5 MODULAR PACKAGED COOLING OPTION	4,956	0.75"	5 HP 208V/3PH/60HZ	GAS FIRED MAKEUP AIR UNIT WITH (2) 24ABB360 5 TON, DUAL CIRCUIT AIR COOLED CONDENSING UNITS. REFER TO SHEET M-402 FOR INFORMATION. 4-5 WEEK LEAD TIME. SHIPPING INCLUDED IN PRICE. SHIPS FROM TYLER, TX. SHIPS SEPARATE, FREIGHT INCLUDED. NOTE: FACTORY OPTIONS SHALL INCLUDE NONCORROSIVE COATING AND HAIL GUARD PROTECTION.

	DIFFUSER & GRILLE SCHEDULE									
DESIGNATION	MANUFACTURER	MODEL NO	TYPE	COLOR	NOM NECK SIZE	NOM FACE SIZE	FRAME TYPE	NC MAX	REMARKS	
A	TITUS	PCS-3	PERFORATED ADJUSTABLE CORE	26 WHITE	PER PLAN	24" x 24"	LAY-IN T-BAR	< 30	INSULATION BLANKET FOR BACKPAN, CONTRACTOR FURNISHED ROUND NECK ADAPTER	
B	TITUS	PCS-3	PERFORATED ADJUSTABLE CORE	26 WHITE	PER PLAN	20" x 20"	SURFACE	< 30	WITH 20X20 SURFACE FRAME, REQUIRES A 20.5"X20.5" CEILING OPENING, INSULATION BLANKET, D-100 RADIAL DAMPER	
C	TITUS	PCS-3	PERFORATED ADJUSTABLE CORE	26 WHITE	PER PLAN	12" x 12"	SURFACE	< 30	WITH12X12 SURFACE FRAME, REQUIRES A 12.5"X12.5" CEILING OPENING, INSULATION BLANKET, D100 RADIAL DAMPER	
D	TITUS	PAR-3	PERFORATED RETURN	26 WHITE	22" x 22"	24" x 24"	LAY-IN T-BAR	< 35	CONTRACTOR FURNISHED INSULATE RETURN BOX FOR CONNECTING FLEX DUCT	
E	TITUS	PAR-3	PERFORATED EXHAUST	26 WHITE	PER PLAN	12" x 12"	SURFACE		WITH12X12 SURFACE FRAME, REQUIRES A 12.5"X12.5" CEILING OPENING, D100 RADIAL DAMPER	
F	TITUS	PAR-3	PERFORATED RETURN	26 WHITE PANDA BRONZE	22" x 22"	24" x 24"	LAY-IN T-BAR	< 35	CONTRACTOR FURNISHED INSULATE RETURN BOX FOR CONNECTING FLEX DUCT	
H	TITUS	PCS-3	PERFORATED ADJUSTABLE CORE	26 WHITE PANDA BRONZE	PER PLAN	24" x 24"	LAY-IN T-BAR	< 30	WITH INSULATION BLANKET, BALANCE USING MANUAL VOLUME DAMPER AT BRANCH DUCT	
J	TITUS	PCS-3	PERFORATED ADJUSTABLE CORE	26 WHITE	PER PLAN	24" x 24"	LAY-IN T-BAR	< 30	AG95 OBD, INSULATION BLANKET FOR BACKPAN, CONTRACTOR FURNISHED ROUND NECK ADAPTER	
K	TITUS	PCS-3	PERFORATED ADJUSTABLE CORE	26 WHITE	PER PLAN	12" x 12"	SURFACE	< 30	WITH12X12 SURFACE FRAME, REQUIRES A 12.5"X12.5" CEILING OPENING, INSULATION BLANKET, D100 RADIAL DAMPER	
L	TITUS	PCS-3	PERFORATED ADJUSTABLE CORE	26 WHITE	PER PLAN	12" x 12"	SURFACE	< 30	WITH12X12 SURFACE FRAME, REQUIRES A 12.5"X12.5" CEILING OPENING	
NOTE: PROVIDE FACTORY INSTALLED BACK PAN INSULATION ON AIR DEVICES. HVAC CONTRACTOR IS TO PURCHASE ALL AIR DEVICES FROM PANDA APPROVED NATIONAL ACCOUNT VENDOR THERMAIR SYSTEMS INC. PLEASE CONTACT RON CAMPTON AT 602-705-5010 OR EMAIL: ronc@thermairsystems.com										

AIR BALANCE SCHEDULE				
ITEM		SUPPLY AIR	RETURN AIR	MAKE-UP AIR
MAU1		0	0	+4,956
EF-1, EF-2		0	0	-3,100 x 2
RTU-1, RTU-2		+4,600, +4000	-3,668, -3,068	2@ +932 EA
EF-3		-	-	-450
TOTAL		+8,600	-6,736	+6,820 -6,650
BUILDING PRESSURE = +170 CFM				
BALANCE TOLERANCES AS FOLLOWS: KITCHEN EXHAUST HOODS: 0% TO +10% OUTDOOR AIR: 0% TO +10% SUPPLY & RETURN DIFFUSERS: ±10% TOILET EXHAUST: ±10% BALANCE RTU SUPPLY AND RETURN PRIOR TO TURNING ON EXHAUST FANS. KITCHEN EXHAUST FANS SHALL BE BALANCED WITH VELOCITY MATRIX OR A 4" ANEMOMETER				

OSA VENTILATION CALCULATION-VMC					
AREA TYPE	TOTAL AREA (FT²)	OCCUPANCY DENSITY (PEOPLE/FT²)	TOTAL OCCUPANTS	OSA REQ'D PER SQ.FT. (CFM)	OSA REQ'D PER PERSON (CFM)
HALLWAYS	32	-	-	0.06	-
STORAGE	0	-	-	0.12	-
KITCHEN (EXHAUST)	763	-	-	0.7	-
DINING ROOM	904	100/1,000	91	20	-
CALCULATION PER VMC TABLE 403.3.1.1 VENTILATION SHALL BE BALANCED BY AN APPROVED METHOD. A BALANCE REPORT SHALL VERIFY THAT THE VENTILATION SYSTEM IS CAPABLE OF SUPPLYING THE AIRFLOW RATES REQUIRED BY SECTION 403. SAID REPORT MUST BE PRESENTED TO THE ADMINISTRATIVE AUTHORITY.				TOTAL OSA REQUIRED (CFM)	1822
				TOTAL OSA PROVIDED (CFM)	1864

MECHANICAL LEGEND		
SYMBOL	ABBREVIATION	DESCRIPTION
	ABV	ABOVE
	AFF	ABOVE FINISHED FLOOR
	CLG	CEILING
	DN	DOWN
		DUCT SECTIONS (SUPPLY, EXHAUST, RETURN)
		FLEXIBLE DUCT
	MVD	MANUAL VOLUME DAMPER
	OBD	OPPOSED BLADE DAMPER
	MFR	MANUFACTURER
	MIN	MINIMUM
	OSA	OUTSIDE AIR
		ROUND RIGID DUCTWORK
	TSP	TOTAL STATIC PRESSURE
		TURNING VANES
		CONSTRUCTION NOTES
		MECHANICAL EQUIPMENT DESIGNATION
		SMOKE DETECTOR
		THERMOSTAT / UNIT
		REMOTE SENSOR / UNIT

MECHANICAL SPECIFICATIONS	
1.	WORK INCLUDES INSTALLATION OF HVAC SYSTEMS, INCLUDING GREASE EXHAUST FANS AND MAKE-UP AIR UNIT FOR KITCHEN HOODS, SPACE HEATING/AIR CONDITIONING SYSTEMS, SUPPLY, RETURN, EXHAUST, AND GREASE EXHAUST DUCTWORK, GRILLES, REGISTERS, DIFFUSERS, COMPLETE CONTROLS SYSTEM, INTERLOCK WIRING FOR OPERATION OF KITCHEN HOODS, EXHAUST FANS, AND MAKE-UP AIR UNIT, DUCT INSULATION, AND RELATED ITEMS NECESSARY FOR A COMPLETE FUNCTIONING SYSTEM AS INDICATED ON THE PLANS. FURNISH ALL NEW MATERIALS AND EQUIPMENT UNLESS NOTED OTHERWISE (U.N.O.).
2.	DRAWINGS FOR HVAC WORK ARE DIAGRAMMATIC, SHOWING THE GENERAL LOCATION, TYPE, LAYOUT AND REQUIRED EQUIPMENT. DRAWINGS SHALL NOT BE SCALED FOR EXACT MEASUREMENTS. AS REQUIRED, REFER TO ARCHITECTURAL AND MANUFACTURER'S STANDARD INSTALLATION DRAWINGS FOR EQUIPMENT CONNECTIONS AND INSTALLATION REQUIREMENTS. FURNISH AND INSTALL DUCTWORK, CONNECTIONS, ACCESSORIES, OFFSETS, AND MATERIALS NECESSARY TO FACILITATE SYSTEM'S FUNCTIONING AS INDICATED BY THE DESIGN AND EQUIPMENT SHOWN ON PLANS.
3.	CODE COMPLIANCE: ALL WORK COVERED BY THIS SECTION SHALL BE IN ACCORDANCE WITH ALL LOCAL CODES AND ACCEPTABLE TO THE AUTHORITY HAVING JURISDICTION.
4.	COORDINATE WORK WITH OTHER TRADES. EQUIPMENT FURNISHED BY OTHERS AND OWNER REQUIREMENTS. PROVIDE DUCT RISES AND DROPS AS REQUIRED FOR INSTALLATION AND/OR TRADE COORDINATION. NOTIFY ARCHITECT OF ANY DISCREPANCIES BEFORE STARTING WORK. WORK SHALL BE PERFORMED BY EXPERIENCED TRADESMEN AND THEIR WORK SHALL BE OF HIGH STANDARD ACCEPTABLE TO THE OWNER.
5.	DUCTWORK: DUCT SYSTEMS SHALL BE CONSTRUCTED, INSTALLED, SEALED AND INSULATED AS PROVIDED IN THE INTL ENERGY AND MECHANICAL CODES. SHEET METAL SHALL BE IN ACCORDANCE WITH ASHRAE AND SMACNA STANDARDS. SHEET METAL SHALL BE GALVANIZED OF LOCK-FORMING QUALITY, ASTM A-525, UNLESS OTHERWISE NOTED. DUCT DIMENSIONS ON DRAWINGS ARE NET INSIDE CLEAR DIMENSIONS ON LINED DUCTS OR SHEET METAL DIMENSIONS ON UNLINED DUCTS. ALL ANGLE IRON USED FOR SUPPORT SHALL BE GALVANIZED. ROUND RIGID DUCTWORK SHALL CONFORM TO SMACNA TABLE 3-2.
6.	INSTALL DUCT HIGH AS POSSIBLE WITHIN JOIST SPACE. CONSULT ARCHITECT AND ENGINEER FOR ALTERNATE ROUTING IF CONFLICT OCCURS.
7.	SEAL ALL TRANSVERSE AND LONGITUDINAL DUCT SEAMS AIR-TIGHT. PROVIDE TURNING VANES AT ALL ELBOWS OR OFFSETS EXCEEDING 30 DEGREES.
8.	GREASE EXHAUST SYSTEM: ALL GREASE EXHAUST DUCTS SHALL BE FABRICATED BY WELDED JOINT CONSTRUCTION OF 16 GAUGE WELDED STEEL OR 18 GAUGE STAINLESS STEEL. PROVIDE RATED ACCESS DOORS AT ALL ELBOWS AND OFFSETS NECESSARY FOR COMPLETE CLEANING OF GREASE DUCT. PROVIDE MINIMUM 30"x30" UNOBSTRUCTED ACCESS OR ROUTE FROM THE CEILING TO EACH ACCESS DOOR. DO NOT BLOCK ACCESS WITH PLUMBING, ELECTRICAL OR HVAC OBSTRUCTIONS. ALL ELBOWS SHALL BE LONG RADIUS. GREASE DUCT SHALL BE INSTALLED EITHER IN A RATED ENCLOSURE PROVIDED BY THE GENERAL CONTRACTOR OR WRAPPED WITH FIREMASTER GREASE DUCT WRAP.
9.	DUCT INSULATION: PROVIDE DUCT WRAP FOR ALL DUCTS ABOVE CEILING, INCLUDING VERTICAL, HORIZONTAL, RIGID AND FLEXIBLE DUCTS. EXCLUDING PREFABRICATED PREINSULATED DUCTS AND GREASE DUCTS. DUCT WRAP SHALL BE JOHNS MANVILLE MICROLITE OR EQUAL WITH FOIL/SCRIMP/KRAFT, 1 IN THICKNESS, 1.5 POUNDS/FT3 DENSITY. DUCT WRAP SHALL BE BONDED GLASS FIBERS IN THERMOSETTING RESIN MEETING NFPA 90A. WITH K VALUE NOT TO EXCEED 0.23 AT 75 DEGREES F. FLAME SPREAD AND SMOKE DEVELOPED RATINGS SHALL NOT EXCEED 25/50. APPLY 100% ADHESIVE COVERAGE TO SHEET METAL DUCTWORK. PROVIDE ADDITIONAL MECHANICAL FASTENERS ON DUCTS OVER 12" WIDE OR 16" HIGH. MECHANICAL FASTENERS SHALL BE "GRIPNAIL" OR WELDED PIN AND SPEED CLIPS SPACED PER SMACNA STANDARDS.
10.	FLEX DUCT: PROVIDE FACTORY ASSEMBLED CLASS 1 AIR DUCT (UL 181) WITH FIBERGLASS INSULATION AND REINFORCED OUTER PROTECTIVE COVER/VAPOR BARRIER. FLEX DUCT SHALL MEET NFPA 90A WITH FLAME SPREAD UNDER 25, SMOKE DEVELOPED UNDER 50 AND SHALL BE RATED FOR 2" W.C. PRESSURE AND 0 TO 250 DEGREE TEMPERATURE. FLEX DUCT MAXIMUM ALLOWED LENGTH TO BE PER LOCAL CODE.
11.	PROVIDE INSULATION APPLIED TO COMPLETE BACKPAN OF AIR DEVICES.
12.	ACCESS DOOR: PROVIDE HINGED ACCESS PANELS IN DUCTWORK WHERE SHOWN AND AS REQUIRED FOR ACCESS TO DAMPERS OR EQUIPMENT. PROVIDE INSULATED ACCESS DOORS IN INSULATED DUCTWORK.
13.	AUTOMATIC TEMPERATURE CONTROL: CONTRACTOR TO PROVIDE AND INSTALL 24/7 PROGRAMMABLE THERMOSTATS AND REMOTE SENSORS.
14.	KITCHEN HOOD EQUIPMENT INTERLOCK: PROVIDE ALL INTERLOCK AND CONTROL WIRING FOR KITCHEN HOOD SYSTEMS, WHICH INCLUDES EF1, EF2, MAU1 AND ANSUL SYSTEM SHUT DOWN INTERLOCK TO MAKE-UP AIR FAN. UPON ACTIVATION OF ANSUL SYSTEM, MAKE-UP AIR FAN SHALL BE DEACTIVATED. PROVIDE ALL NECESSARY CONTROLS AND WIRING FOR A COMPLETE AND OPERABLE SYSTEM. INTERLOCK GREASE EXHAUST FANS AND MAKE-UP AIR UNIT TO START SIMULTANEOUSLY FROM SWITCH PROVIDED AT HOOD.
15.	TEST AND ADJUST EACH PIECE OF EQUIPMENT AND EACH SYSTEM AS REQUIRED TO ASSURE PROPER AIR BALANCE AND OPERATION. PROVIDE A CERTIFIED AIR BALANCE REPORT TO OWNER SHOWING DESIGN AND MEASURED AIR VOLUMES, STATIC PRESSURES, FAN RPMs, ETC. AIR BALANCE CONTRACTOR SHALL ADJUST SYSTEMS TO MINIMIZE NOISE AND VIBRATION, AND TO ASSURE PROPER FUNCTION OF CONTROLS, MAINTENANCE OF TEMPERATURE AND OPERATION. GENERAL CONTRACTOR TO OBTAIN ALL INSPECTIONS REQUIRED BY LOCAL CODE AND GUARANTEE WORK AND INSTALLATION FOR ONE YEAR AFTER ACCEPTANCE BY OWNER. GENERAL CONTRACTOR TO FURNISH OWNER WITH TWO COMPLETE SETS OF AS-BUILT DRAWINGS INDICATING ALL INSTALLED WORK, INCLUDING ALL CONTROL WIRING DIAGRAMS AND INTERLOCK FOR SYSTEM OPERATION.
16.	CONTRACTOR SHALL BE RESPONSIBLE FOR INSTALLATION OF ECONOMIZERS INCLUDING INSTALLATION OF ALL NECESSARY SENSORS AND CONNECTIONS TO THERMOSTAT. PROVIDE SUPPORT OF ECONOMIZERS PER MANUFACTURER'S REQUIREMENTS AND TEST FOR PROPER OPERATION PRIOR TO FINAL TEST AND BALANCE.



PANDA RESTAURANT GROUP INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:


NO.	COMMENTS/OWNER REV	DATE
1	CHECK SET	10-23-20
2	PERMIT SET	03-15-21
3	BID SET	04-02-21

ISSUE DATE:

1	CHECK SET	10-23-20
2	PERMIT SET	03-15-21
3	BID SET	04-02-21

DRAWN BY:

PANDA PROJECT #: S4-21-D7864
ARCH PROJECT #: P7350

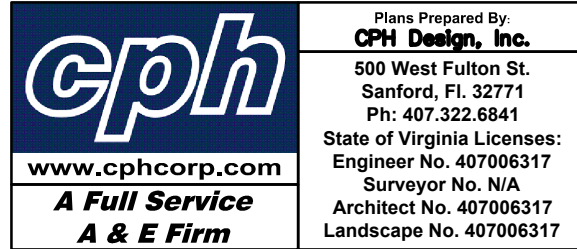

PANDA EXPRESS
END CAP - TENANT BUILD OUT
4501 S LABURNUM AVE
RICHMOND VA, 23231

M-000
MECHANICAL NOTES
SPECIFICATIONS & SCHEDULES